
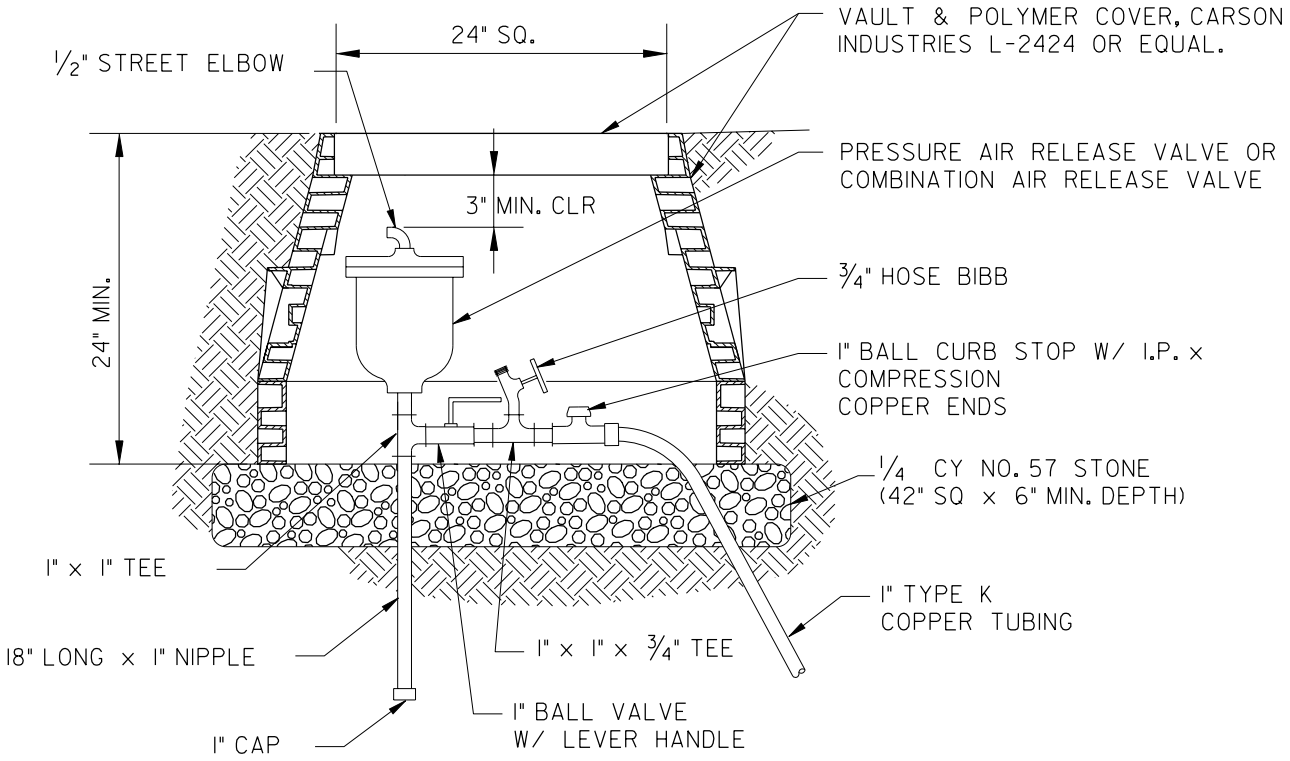


NOTES

1. LOCATE AS DIRECTED BY ENGINEER.
2. PIPING INSIDE VAULT TO BE GALVANIZED UNLESS NOTED OTHERWISE.
3. USE 1" TYPE K COPPER TUBING, 36" MINIMUM COVER.
4. TUBING SHALL HAVE A POSITIVE GRADE FROM WATER MAIN TO AIR RELEASE VALVE ASSEMBLY.

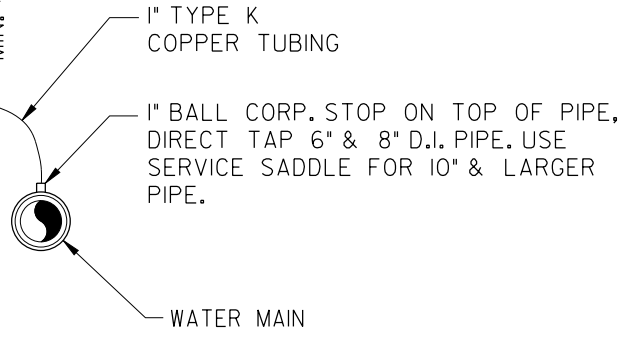

DETAIL

CITY OF EMERSON
WATER & SEWER DEPARTMENT

AIR RELEASE VALVE
CONSTRUCTION STANDARD

DATE:	8/15/2008
REVISION DATE	
REVISION DATE	
REVISION DATE	
REVISION DATE	

STANDARD
DETAIL
NO.
5.19