


NOTES

1. LOCATE AS DIRECTED BY ENGINEER.
2. PIPING INSIDE VAULT TO BE GALVANIZED UNLESS NOTED OTHERWISE.
3. USE 1" TYPE K COPPER TUBING, 36" MINIMUM COVER.
4. TUBING SHALL HAVE A POSITIVE GRADE FROM WATER MAIN TO AIR RELEASE VALVE ASSEMBLY.

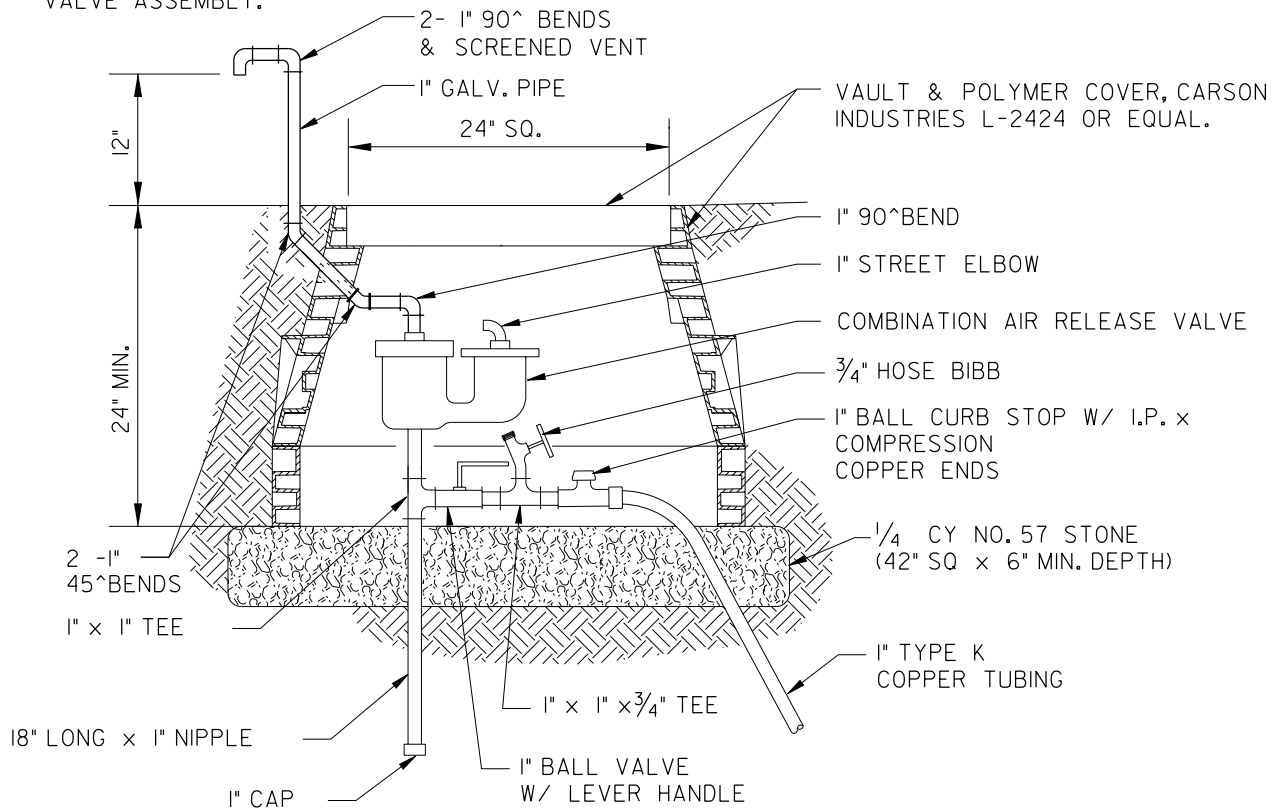

DETAIL

<p>CITY OF EMERSON WATER & SEWER DEPARTMENT</p>	<p>AIR/VACUUM VALVE CONSTRUCTION STANDARD</p>	DATE: 8/15/2008	<p>STANDARD DETAIL NO. 5.20</p>
		REVISION DATE	
		REVISION DATE	
		REVISION DATE	
		REVISION DATE	